


WEATHER HOUSING W/SOUND UPFIT

15/30 RESA
WEATHER HOUSING WITH SOUND UPFIT
& 150 MPH HIGH WIND MOUNTING DETAIL



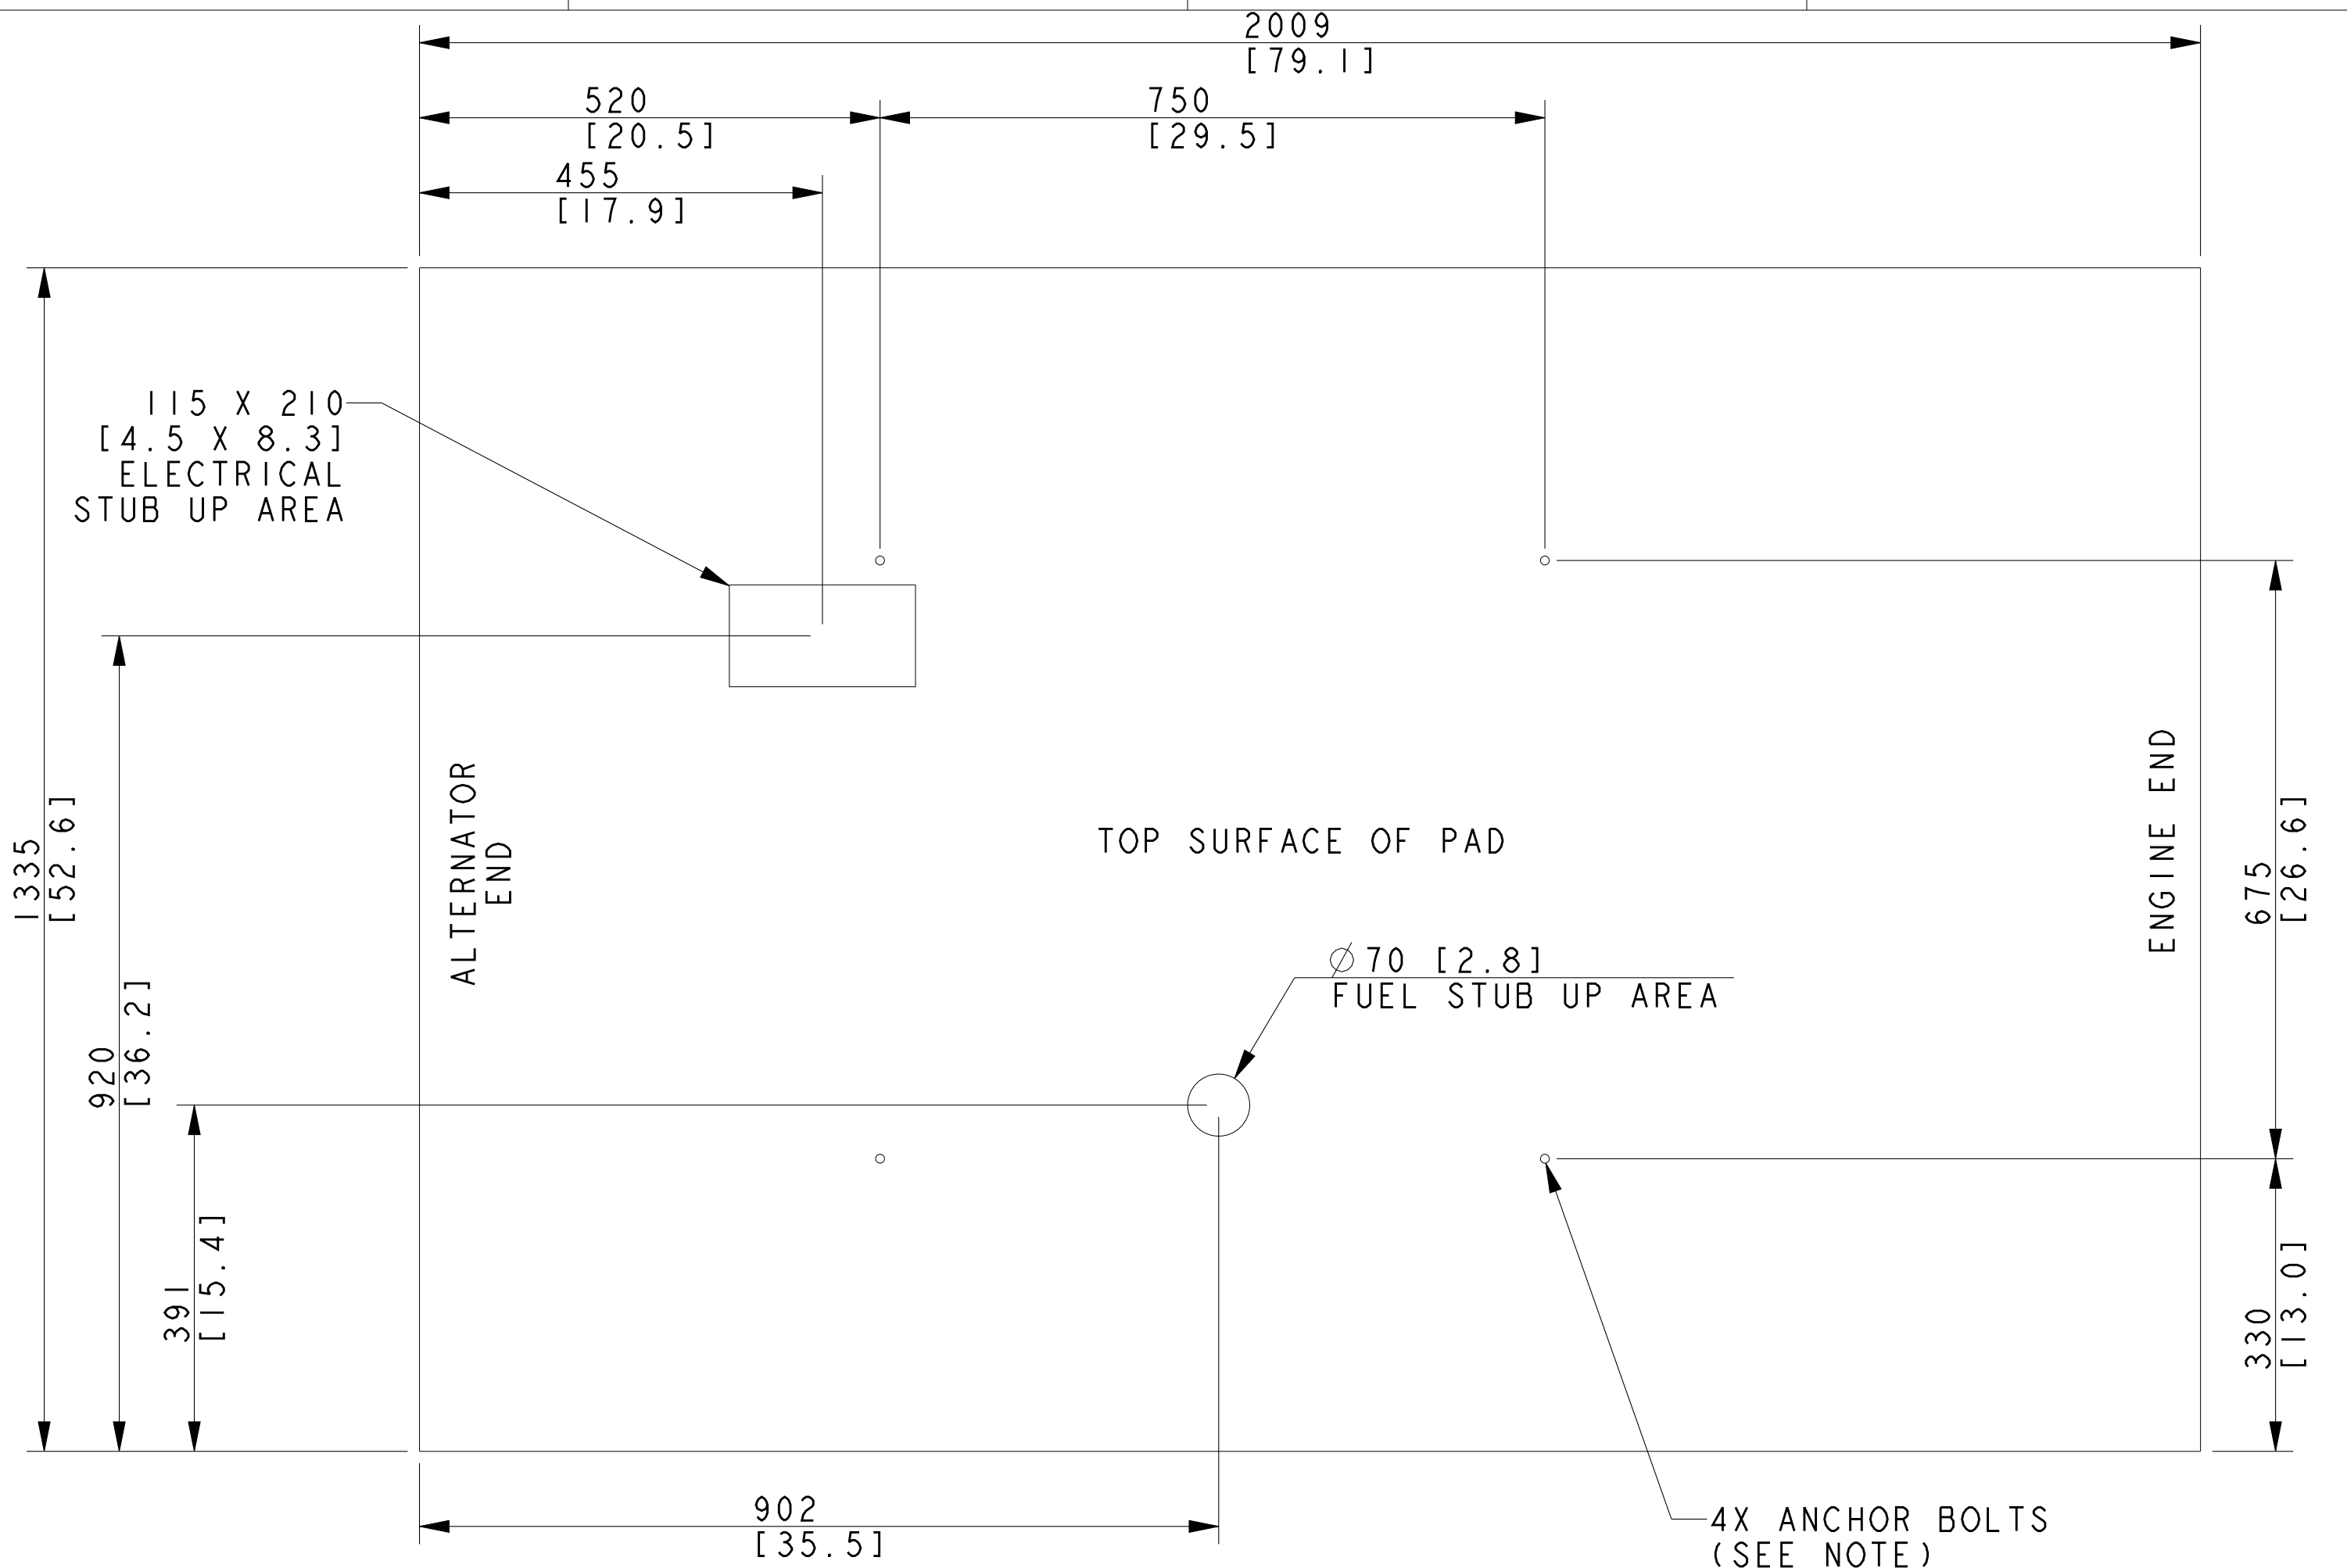


MOUNTING PAD DETAIL
127 [5.0] MINIMUM THICKNESS
FOR WEATHER HOUSING WITH SOUND UPFIT KIT

NOTES
ANCHOR BOLTS WILL BE SUBJECTED TO:
-PULL-OUT FORCE OF 337 Kg [744 LBS.]
-SHEAR LOAD OF 170 Kg [375 LBS.]
SIZE ANCHOR BOLTS BASED ON THESE
VALUES INCLUDING A SAFETY FACTOR
DETERMINED BY STATE CODES.


NOTE
DIMENSIONS IN [] ARE INCH EQUIVALENTS.

| REV | DATE | ON COMPOSITE DWGS. SEE PART NO. FOR REVISION LEVEL | BY | UNLESS OTHERWISE SPECIFIED - 1) DIMENSIONS ARE IN MILLIMETERS 2) TOLERANCES ARE: | APPROVALS | DATE | KOHLER CO. METRIC PRO-E POWER SYSTEMS, KOHLER, WI 53044 U.S.A. THIS DRAWING IN DESIGN AND DETAIL IS KOHLER CO. PROPERTY AND MUST NOT BE USED EXCEPT IN CONNECTION WITH KOHLER CO. WORK. ALL RIGHTS OF DESIGN OR INVENTION ARE RESERVED. TITLE DIMENSION PRINT, 15/30 KW GM1.6L ENCLOSURE SCALE 0.15 CAD NO. SHEET 1 of 3 DWG NO. ADV-7694 |
|-----|----------|---|-----|--|-----------|---------|--|
| - | 4-27-09 | NEW DRAWING [87252-5] | DDH | X.XX ± X.X ± | APPROVED | 4-27-09 | |
| A | 12-17-09 | (A-4) 15/30 RESA WAS 15/30ERES [88856] | SAM | X ° ± | CHECKED | 4-27-09 | |
| B | 3-30-10 | (A-4,5) 725 WAS 685 (B-3,4) 778 WAS 736 (C-1) 675 WAS 635 (C-4) 1335 WAS 1295, 920 WAS 880 [89348] | BAL | THIRD ANGLE PROJECTION | APPROVED | 4-27-09 | |

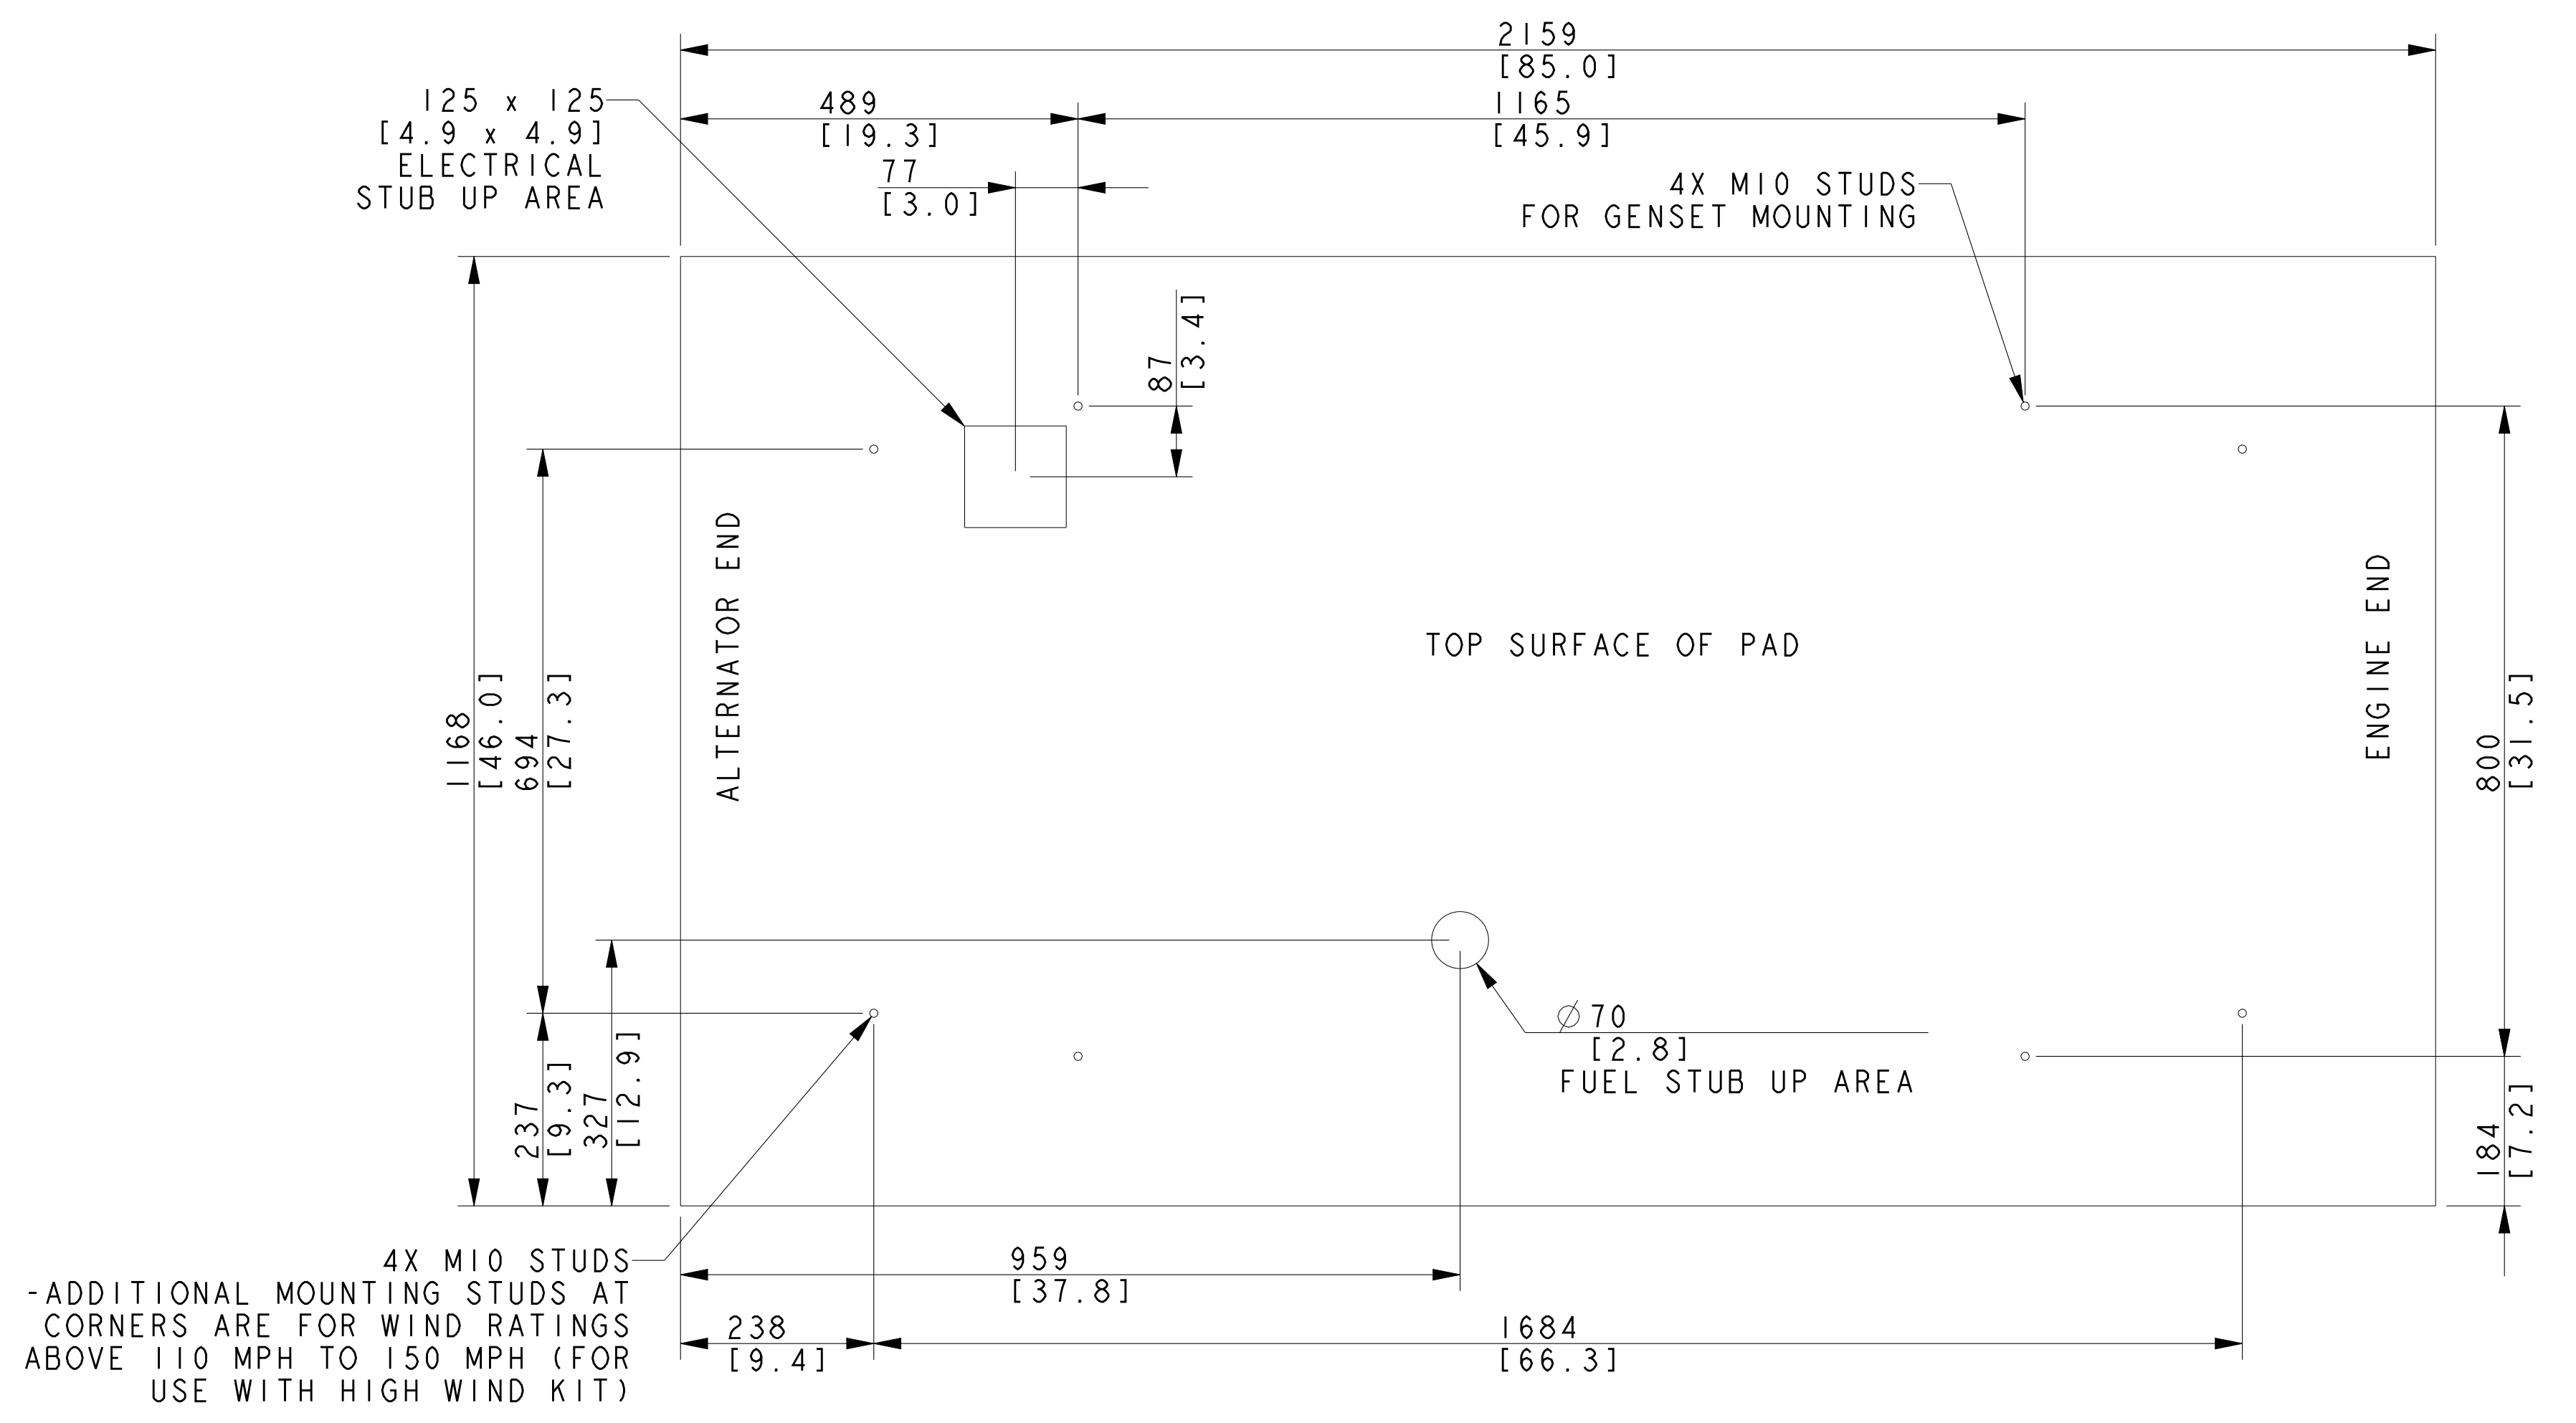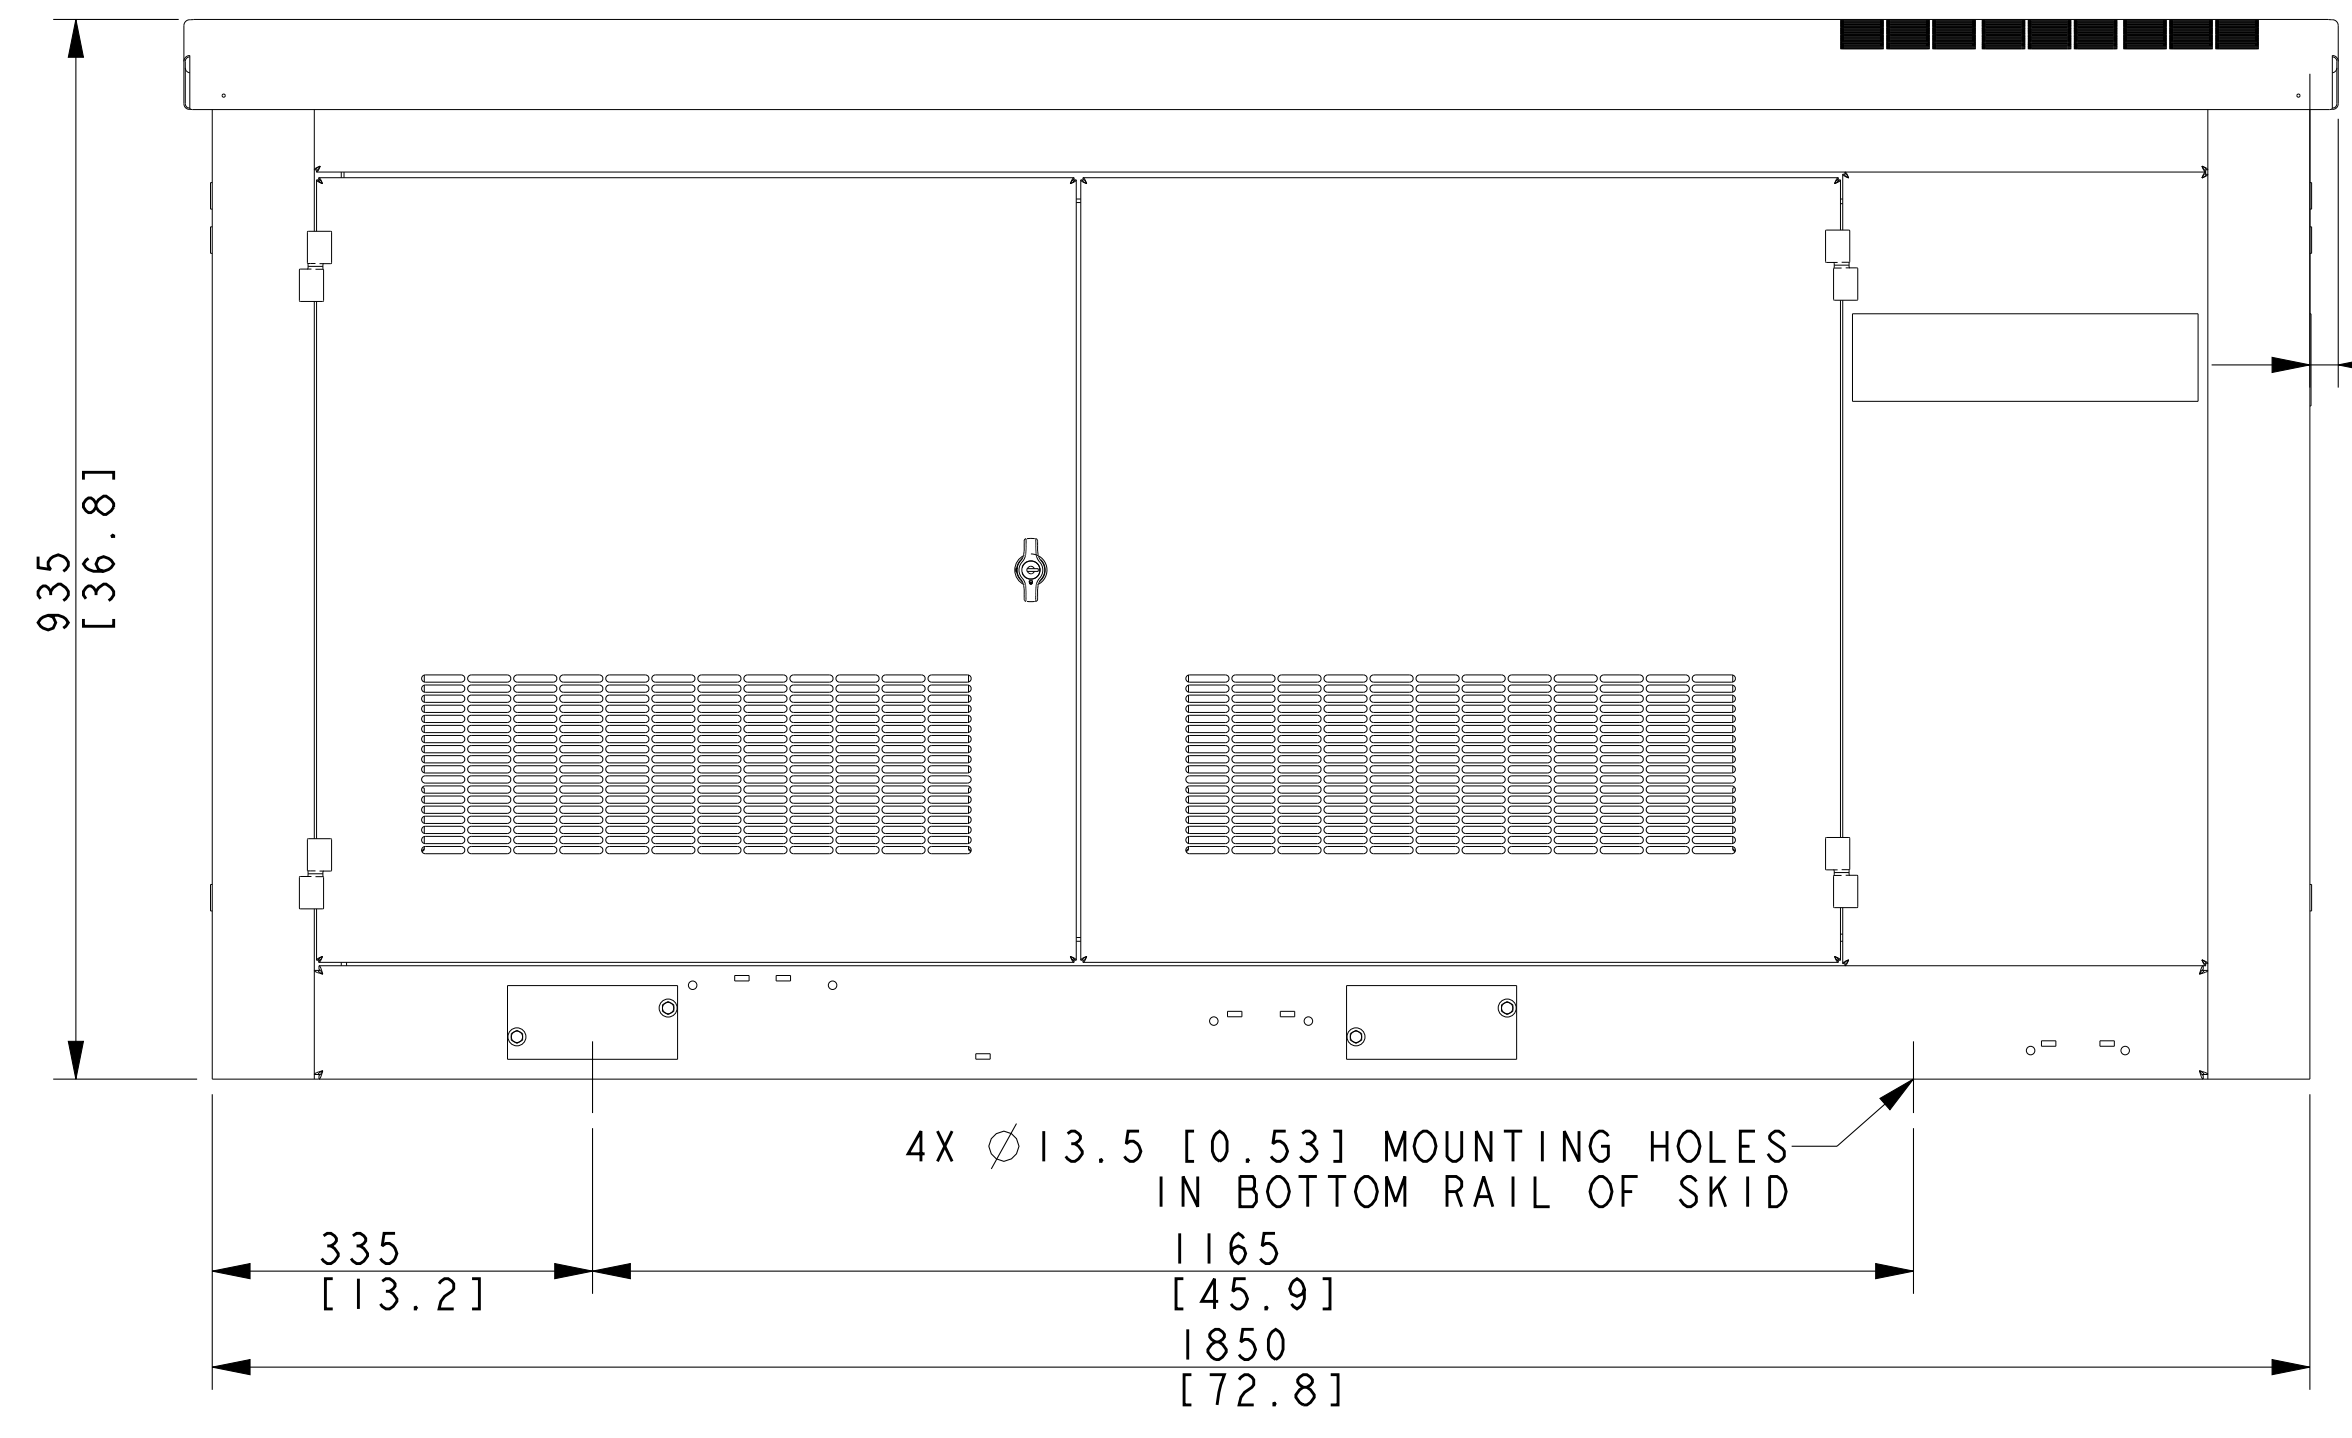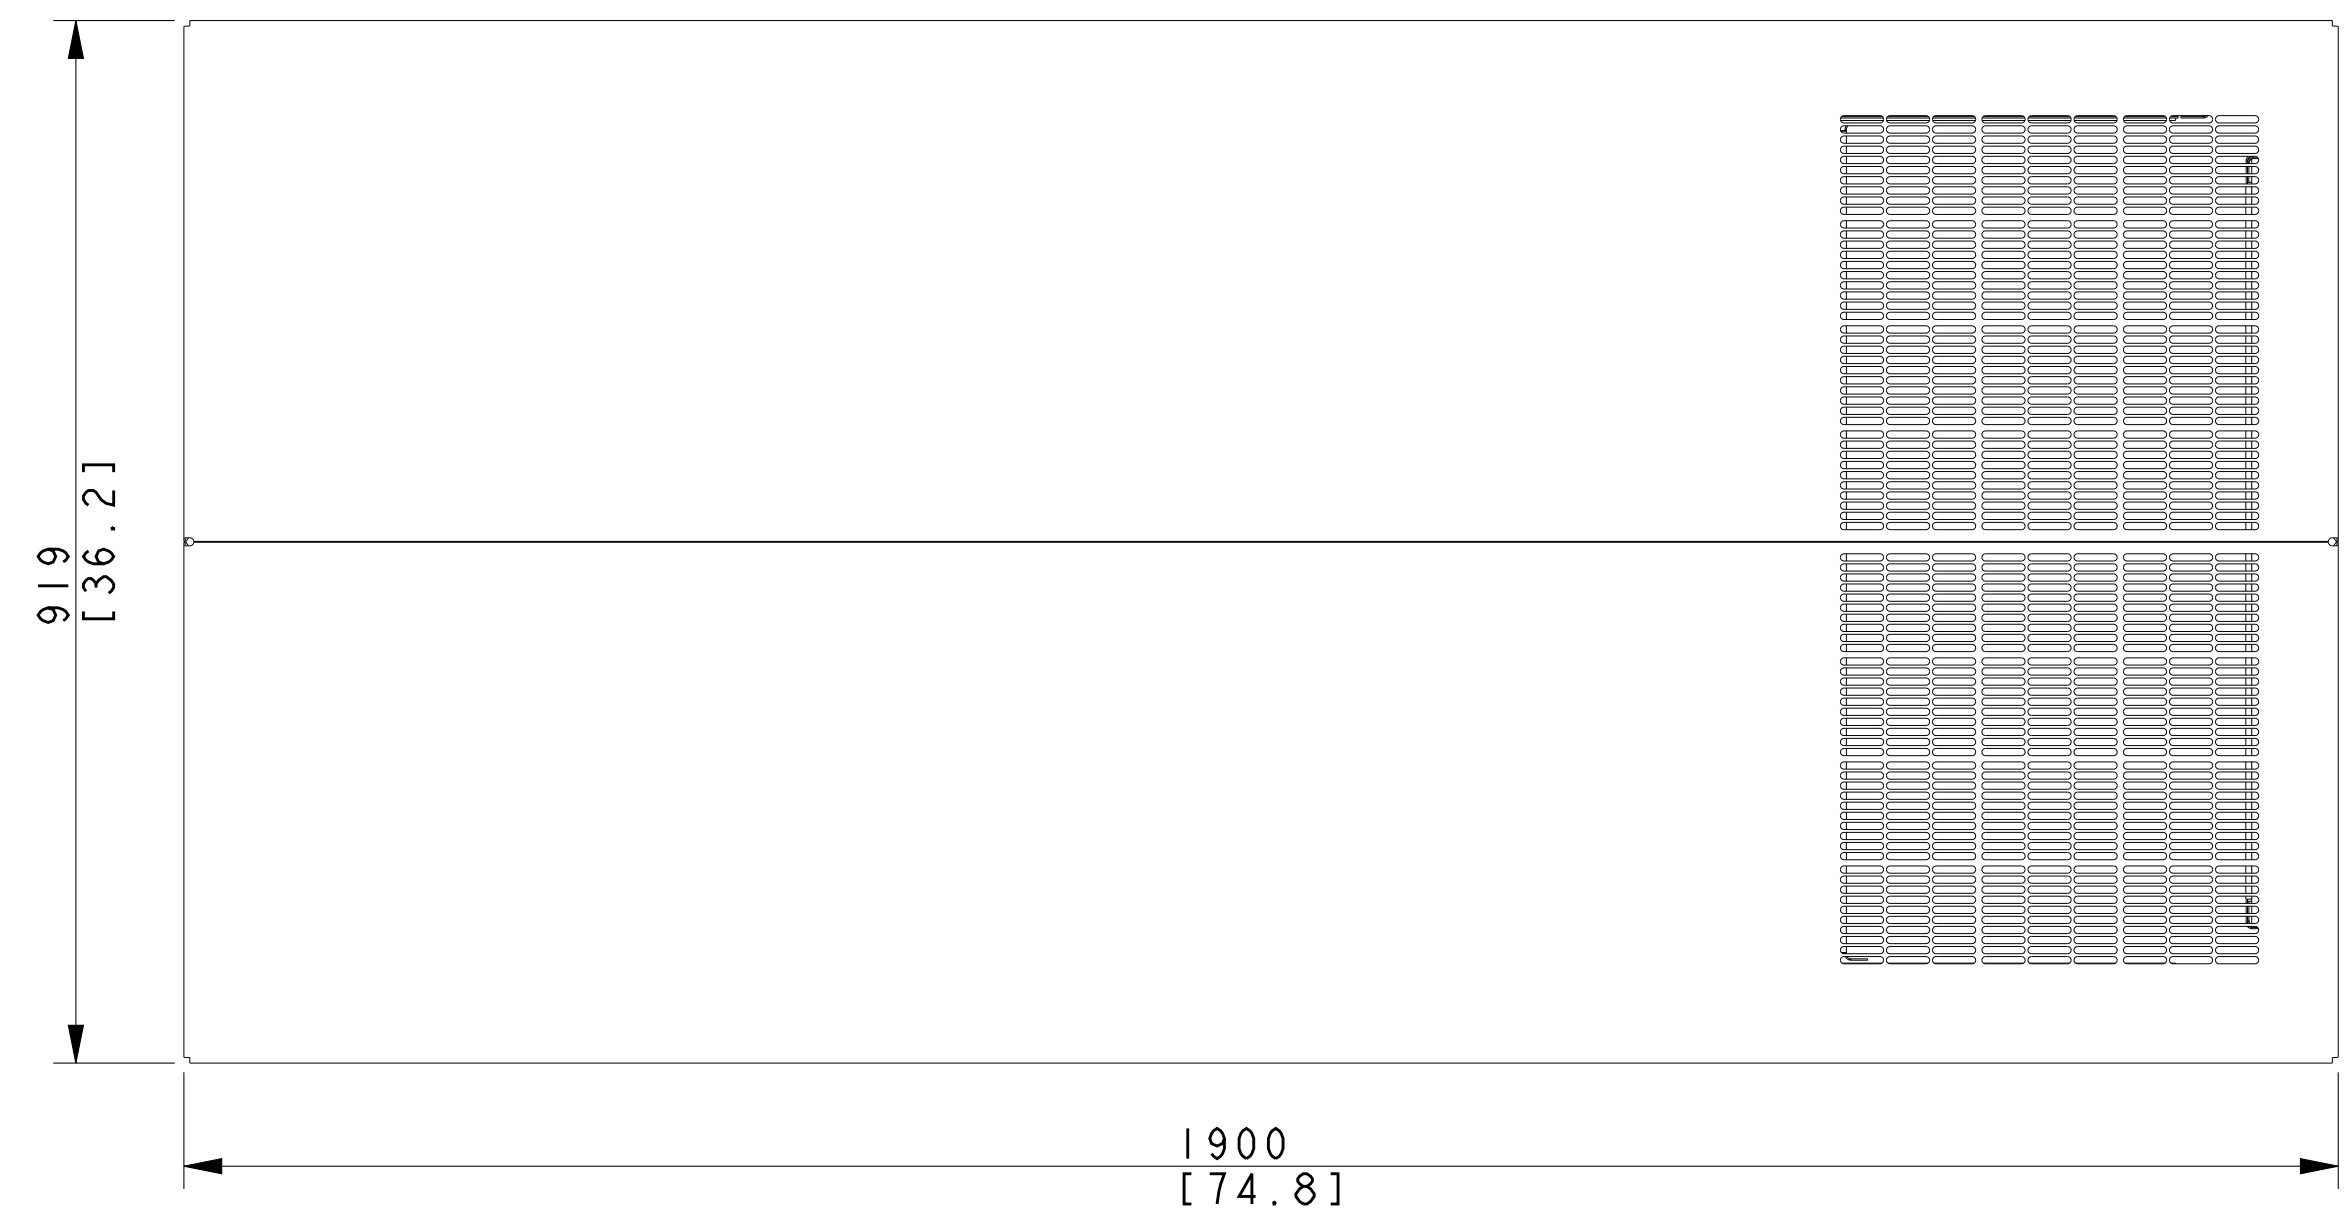

4X M10 STUDS - ADDITIONAL MOUNTING STUDS AT CORNERS ARE FOR WIND RATINGS ABOVE 110 MPH TO 150 MPH (FOR USE WITH HIGH WIND KIT)

MOUNTING PAD DETAIL
127 [5.0] MINIMUM THICKNESS
FOR USE WITH SKID MOUNTED SOUND SHIELD ONLY

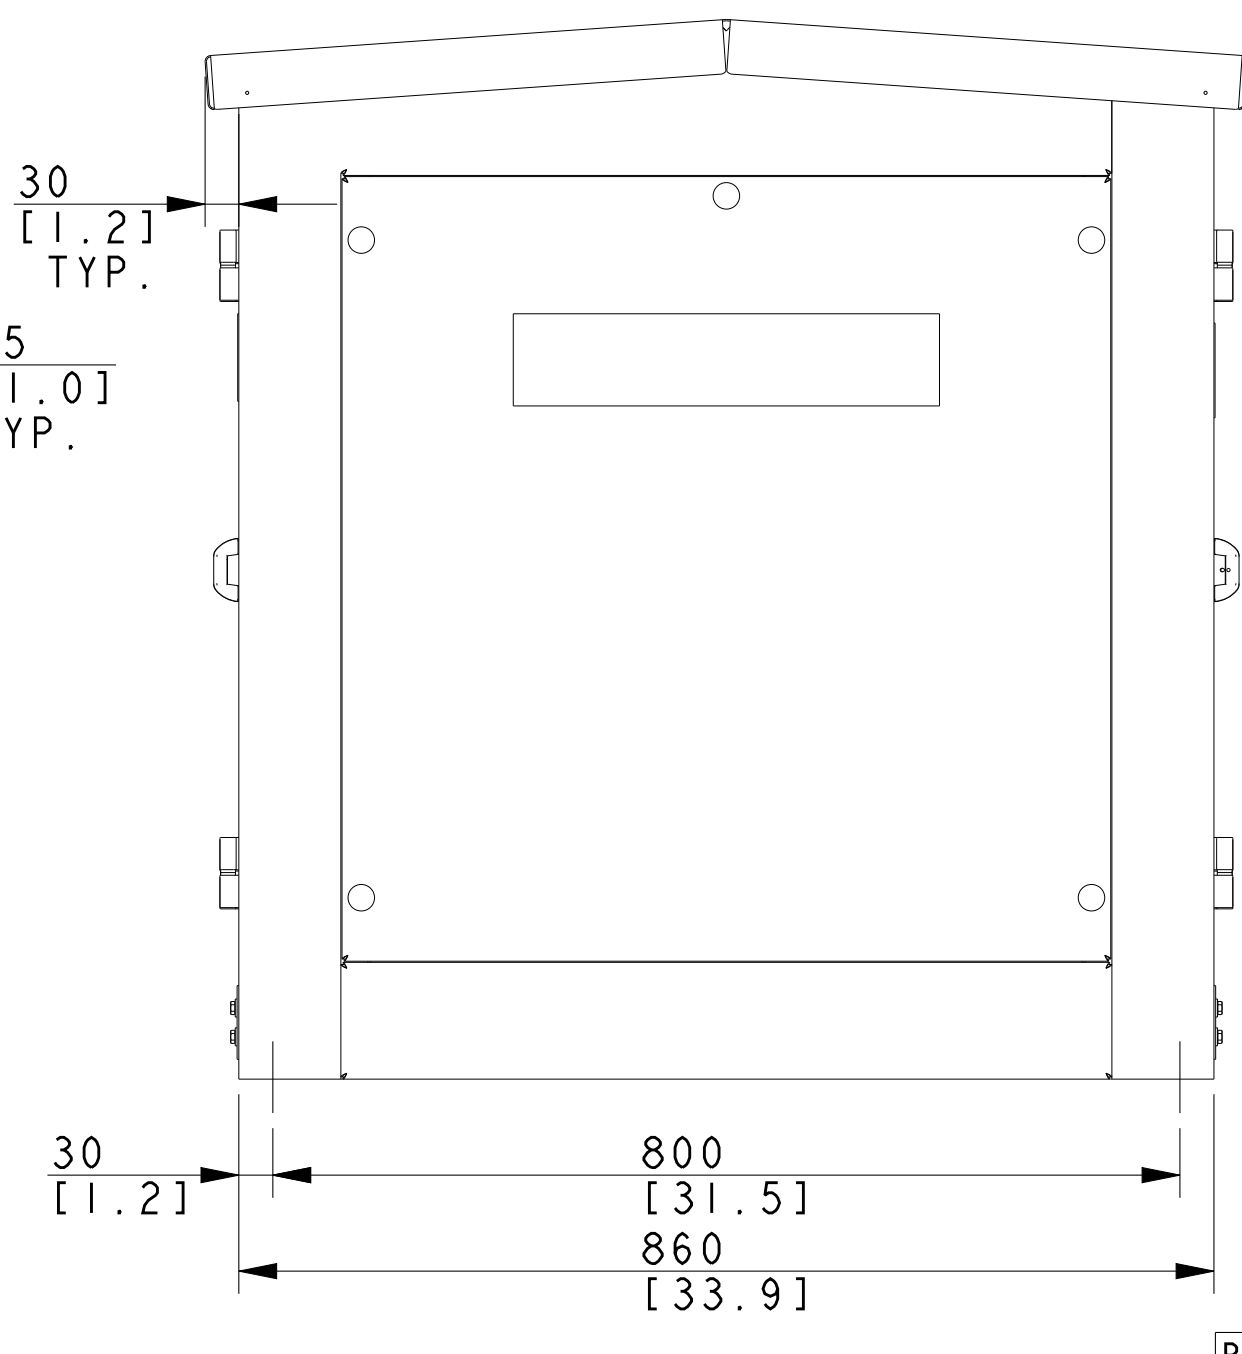


15/30 RESA
SOUND SHIELD



NOTE
DIMENSIONS IN [] ARE INCH EQUIVALENTS.

| REV | DATE | ON COMPOSITE DWGS. SEE PART NO. FOR REVISION LEVEL | BY | UNLESS OTHERWISE SPECIFIED - 1) DIMENSIONS ARE IN MILLIMETERS 2) TOLERANCES ARE: | APPROVALS | DATE | TITLE |
|-----|----------|--|-----|--|-----------|------|---|
| - | 4-27-09 | NEW DRAWING [87252-5] | DDH | X.XX ± | | | KOHLER CO. METRIC PRO-E POWER SYSTEMS, KOHLER, WI 53044 U.S.A. THIS DRAWING IN DESIGN AND DETAIL IS KOHLER CO. PROPERTY AND MUST NOT BE USED EXCEPT IN CONNECTION WITH KOHLER CO. WORK. ALL RIGHTS OF DESIGN OR INVENTION ARE RESERVED. DIMENSION PRINT, 15/30 KW GM1.6L ENCLOSURE |
| A | 12-17-09 | (A-4) 15/30 RESA WAS 15/30ERES [88856] | SAM | X.X ± | | | |
| B | 3-31-10 | SEE SHEET 1 [89348] | BAL | ANGLES ± | | | SCALE 0.15 CAD NO. SHEET 2 of 3 DWG NO. ADV-7694 |
| | | | | | APPROVED | JAS | 4-27-09 |


RESIDENTIAL INSTALLATION GUIDE

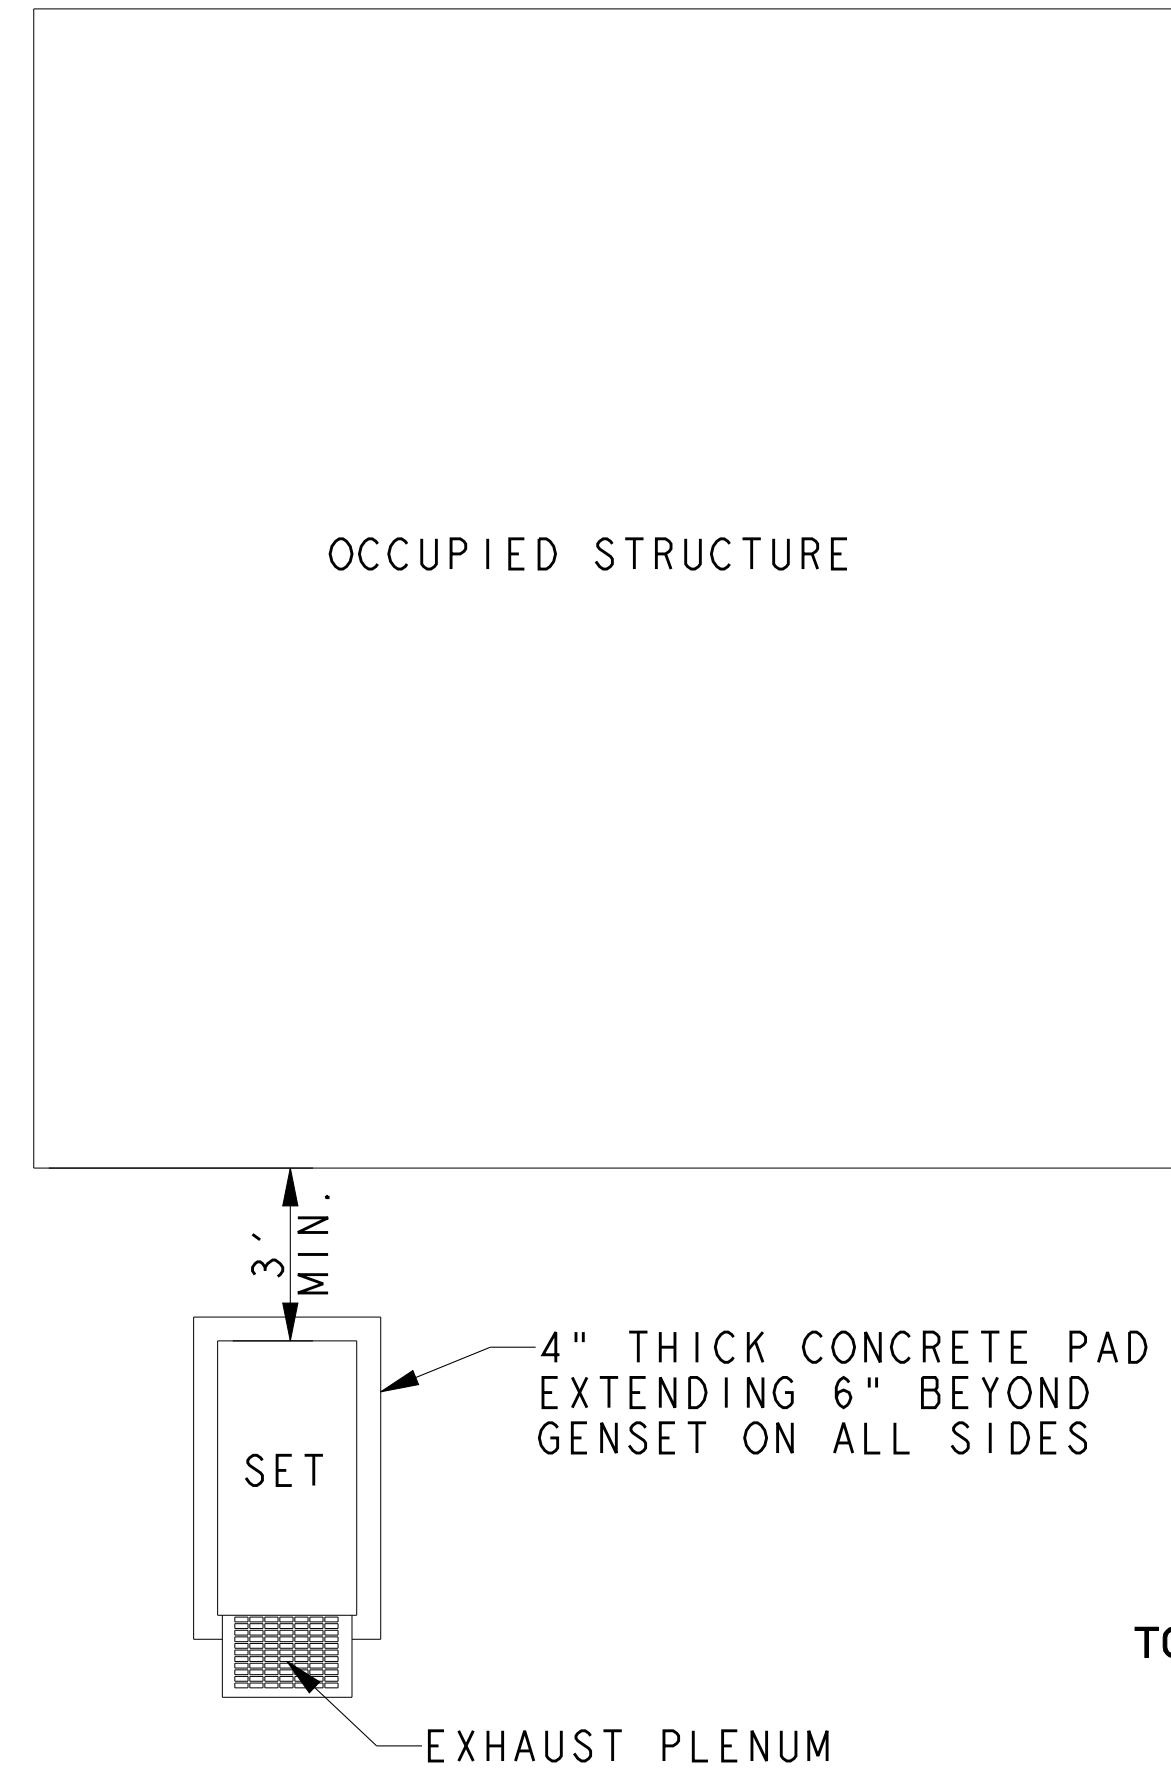

TOP VIEW

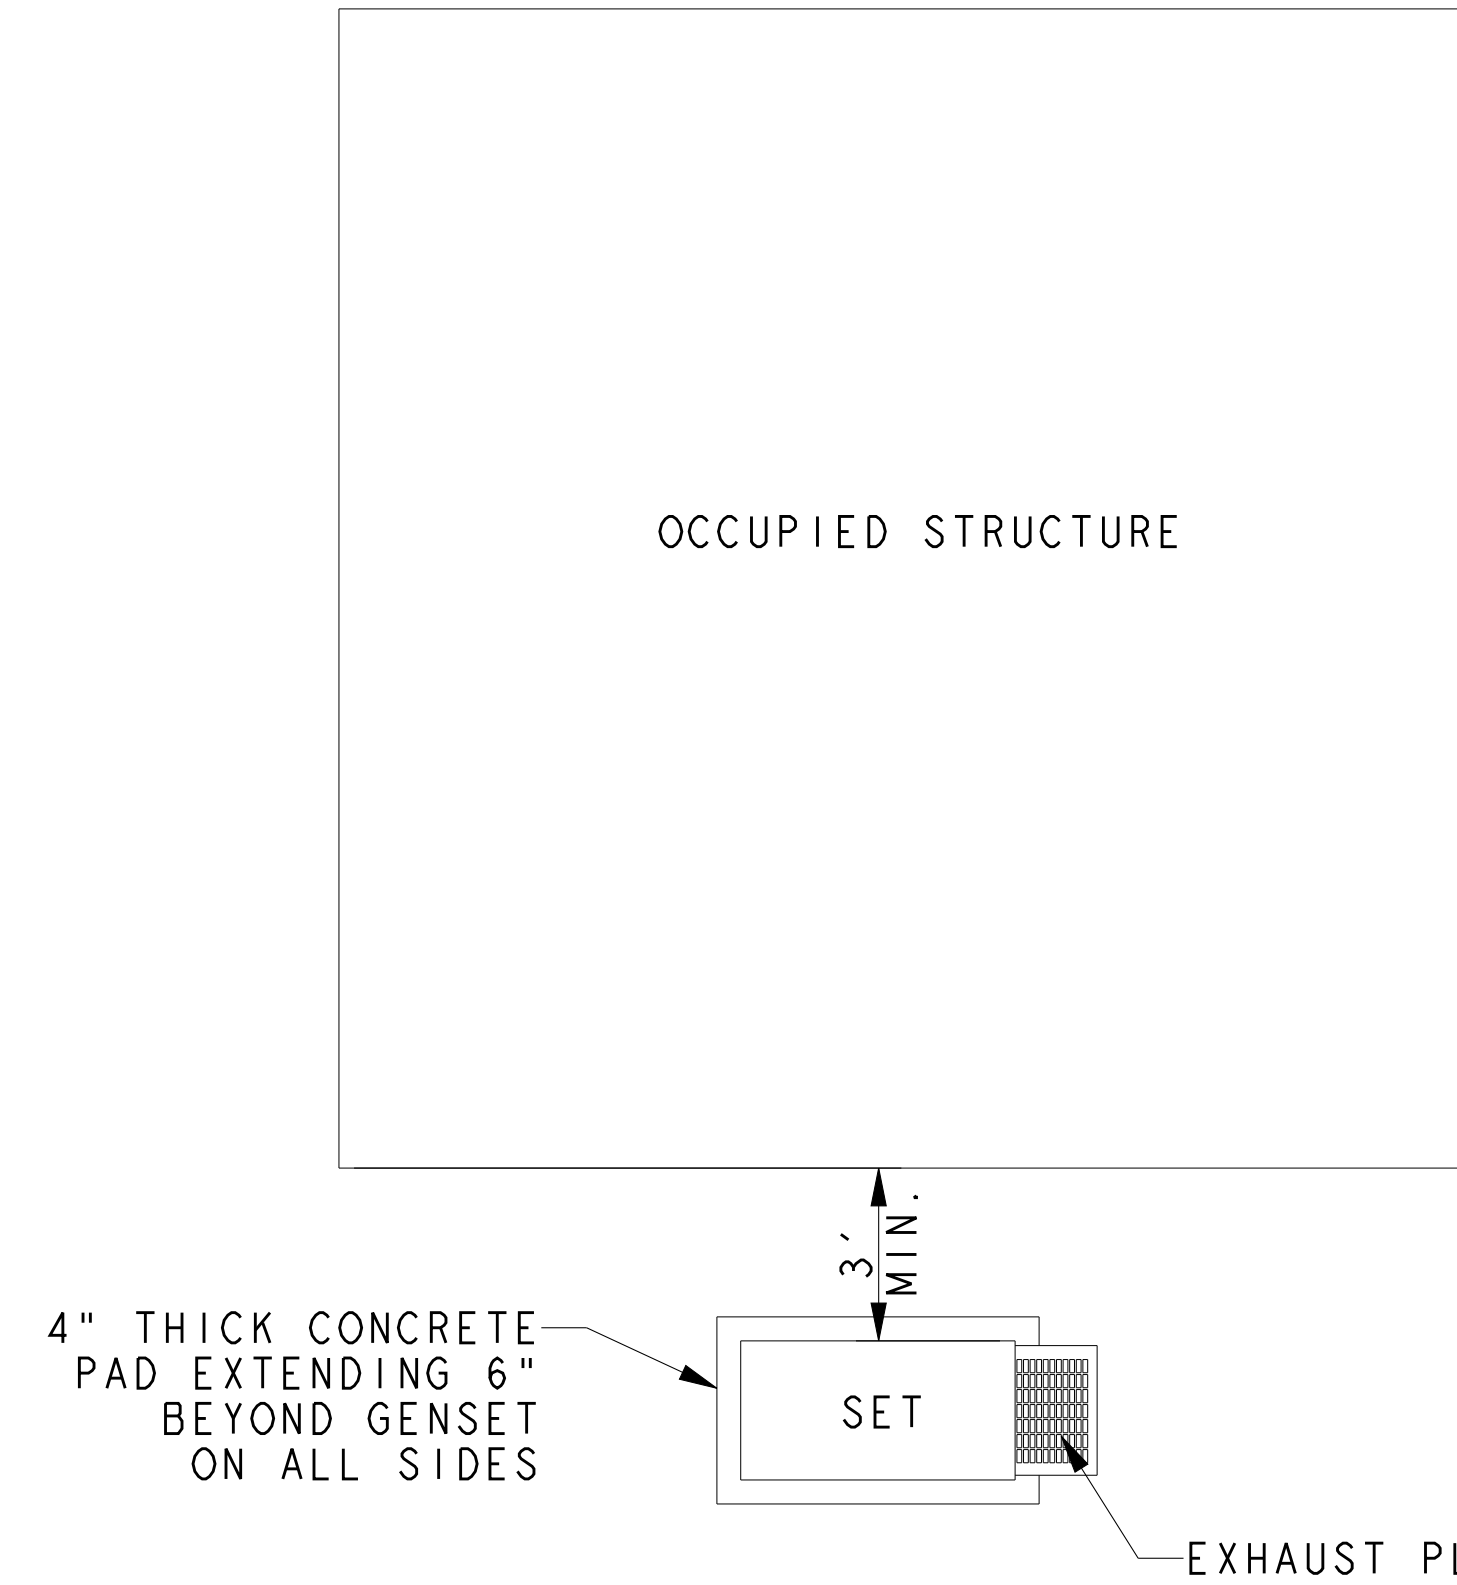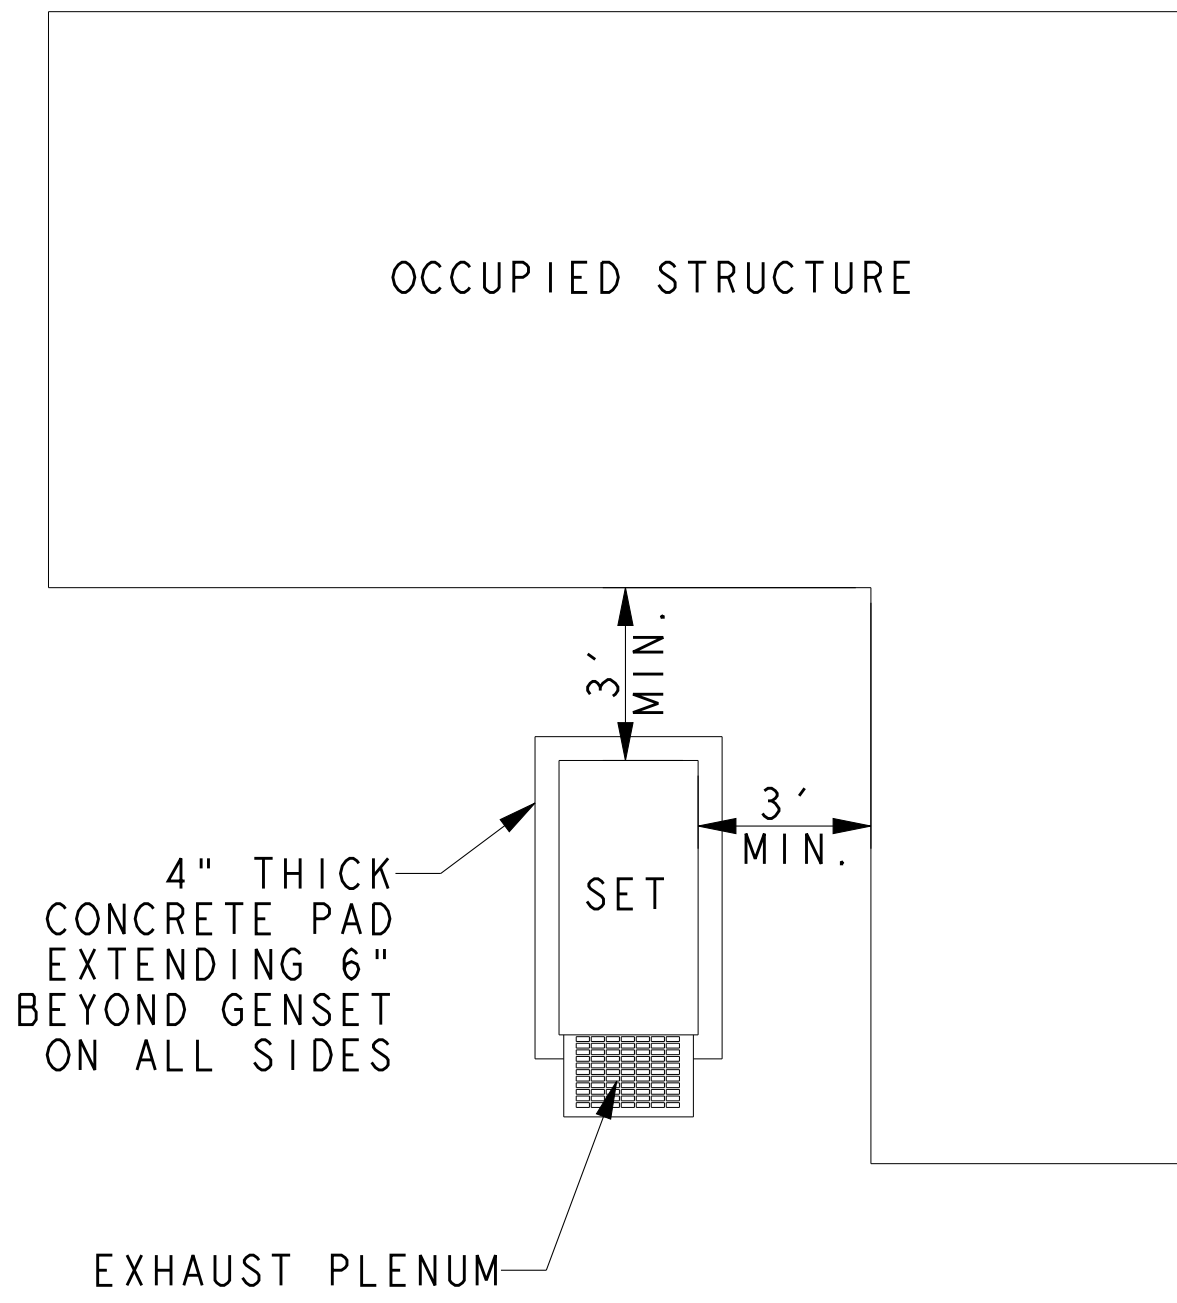


TOP VIEW

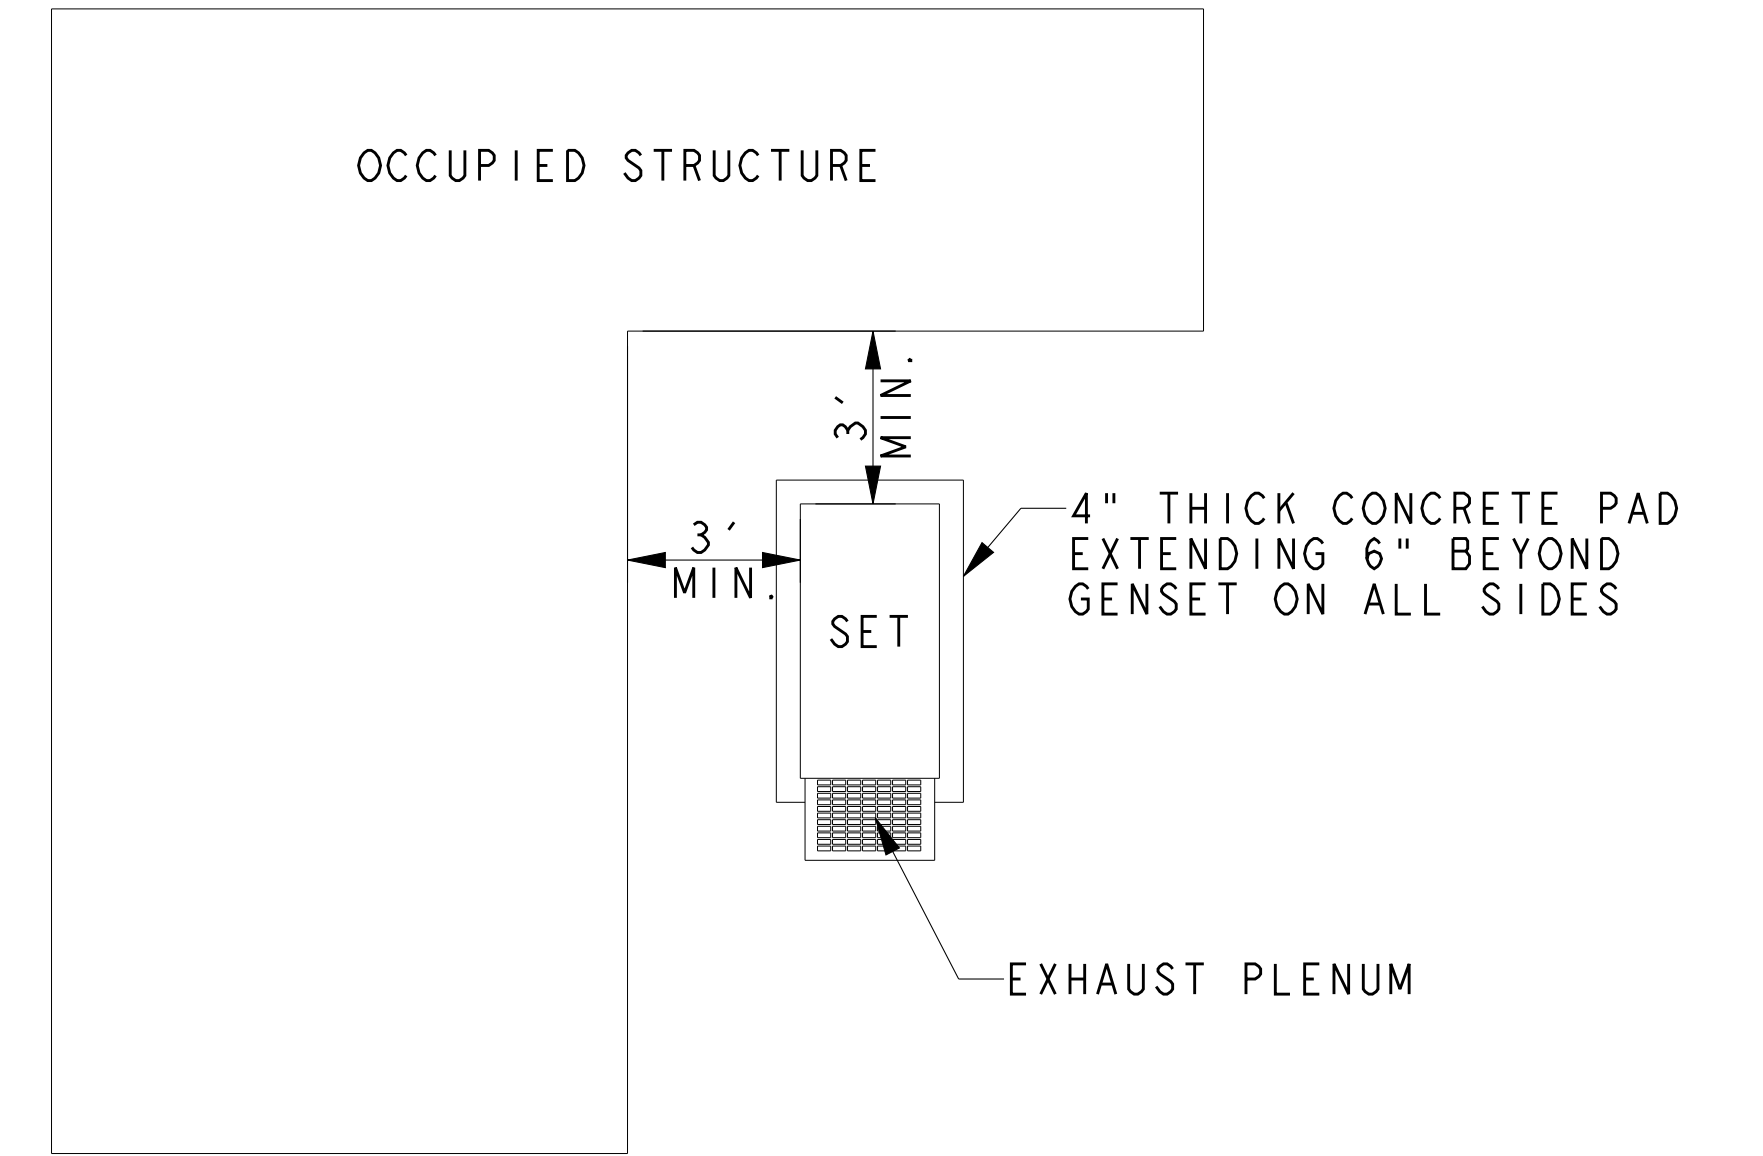

TOP VIEW

- PREFERRED**
- 1) EXHAUST END IS AWAY FROM THE STRUCTURE.
 - 2) EXHAUST IS NOT DIRECTED AT PLAY AREAS, PATIOS, UNDER OVERHANGS OR AREAS WHERE PEOPLE CONGREGATE.
 - 3) THE NEAREST WINDOW, VENT, DOOR OR SIMILAR STRUCTURE OPENING IS AT LEAST 5' FROM THE EXHAUST END OF THE SET.
 - 4) SET HAS PROPER OFFSET FROM STRUCTURE.
 - 5) WINDOWS & DOORS ON ADJACENT WALLS ARE CLOSED.
 - 6) FURNACE AND OTHER SIMILAR INTAKES ARE AT LEAST 10' FROM EXHAUST END OF SET.
 - 7) REFER TO OWNERS MANUAL FOR OTHER INSTALLATION CONSTRAINTS.

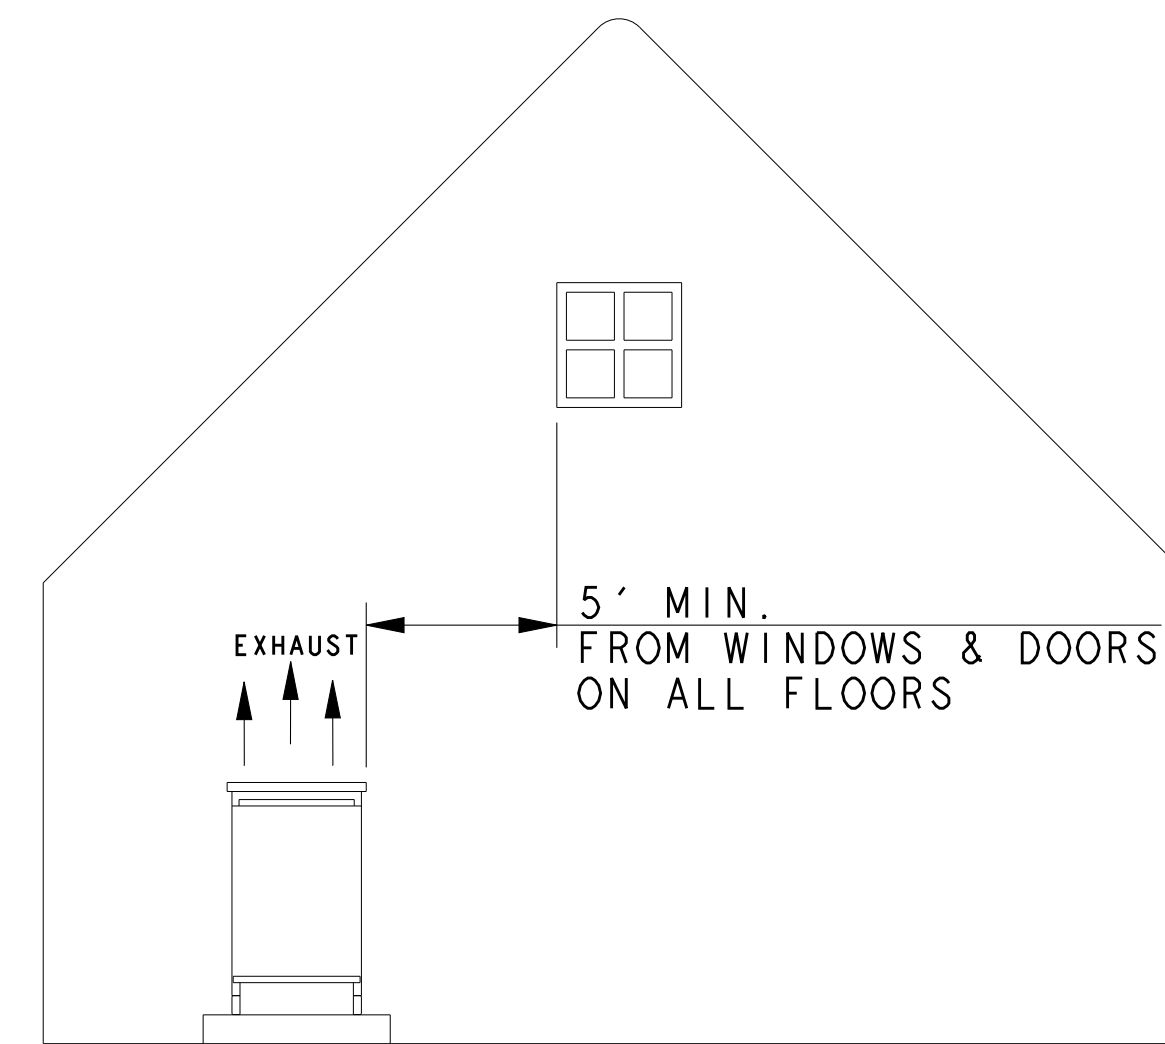

FRONT ELEVATION VIEW

- ACCEPTABLE**
- 1) EXHAUST IS AWAY OR PARALLEL TO STRUCTURE.
 - 2) EXHAUST IS NOT DIRECTED AT PLAY AREAS, PATIOS, UNDER OVERHANGS OR AREAS WHERE PEOPLE CONGREGATE.
 - 3) THE NEAREST WINDOW, VENT, DOOR OR SIMILAR STRUCTURE OPENING IS AT LEAST 5' FROM THE EXHAUST END OF THE SET.
 - 4) SET HAS PROPER OFFSET FROM STRUCTURE.
 - 5) WINDOWS & DOORS ON ADJACENT WALLS ARE CLOSED.
 - 6) FURNACE AND OTHER SIMILAR INTAKES ARE AT LEAST 10' FROM EXHAUST END OF SET.
 - 7) REFER TO OWNERS MANUAL FOR OTHER INSTALLATION CONSTRAINTS.

| REV | DATE | ON COMPOSITE DWGS. SEE PART NO. FOR REVISION LEVEL | BY | UNLESS OTHERWISE SPECIFIED - 1) DIMENSIONS ARE IN MILLIMETERS 2) TOLERANCES ARE: | APPROVALS | DATE | TITLE |
|-----|----------|--|-----|--|-----------|---------|--|
| - | 4-27-09 | NEW DRAWING [87252-5] | DDH | X.XX ± | DDH | 4-27-09 | KOHLER CO. METRIC PRO-E POWER SYSTEMS, KOHLER, WI 53044 U.S.A. THIS DRAWING IN DESIGN AND DETAIL IS KOHLER CO. PROPERTY AND MUST NOT BE USED EXCEPT IN CONNECTION WITH KOHLER CO. WORK. ALL RIGHTS OF DESIGN OR INVENTION ARE RESERVED. TITLE DIMENSION PRINT, 15/30 KW GM1.6L ENCLOSURE SCALE 0.40 CAD NO. SHEET 3 of 3 DNG NO. ADV-7694 D |
| A | 12-17-09 | (A-4) 15/30 RESA WAS 15/30ERES [88856] | SAM | X.X ± | DDH | 4-27-09 | |
| B | 3-31-10 | SEE SHEET 1 [89348] | BAL | ANGLES ± | DDH | 4-27-09 | |
| | | | | | JAS | 4-27-09 | |

15/30 RESA